

APP CRS	Rwy Idg	9000
095°	TDZE	1000
	Apt Elev	1026

RNAV (RNP) Z RWY 10

HARTSFIELD-JACKSON ATLANTA INTL (ATL)


▼

For uncompensated Baro-VNAV systems, procedure NA below -8°C (18°F) or above 54°C (130°F). GPS required. Simultaneous approach authorized; arrival from ROBNS NA. For inop ALS, increase RNP 0.11 DA all Cats visibility to RVR 4500.

ALSF-2

MISSED APPROACH: Climb to 1500 then climbing right turn to 3000 direct SCARR and hold.

D-ATIS	ATLANTA	ATLANTA TOWER					ALL	GND CON			ALL
ARR 119.65	APP CON	8L-26R	8R-26L	9L-27R	9R-27L	10-28	RWYS	(8L-26R,8R-26L)	(9L-27R,9R-27L)	10-28	RWYS
DEP 125.55	127.9 379.9	119.1	125.325	123.85	119.3	119.5	254.4	121.9	121.75	121.65	254.4

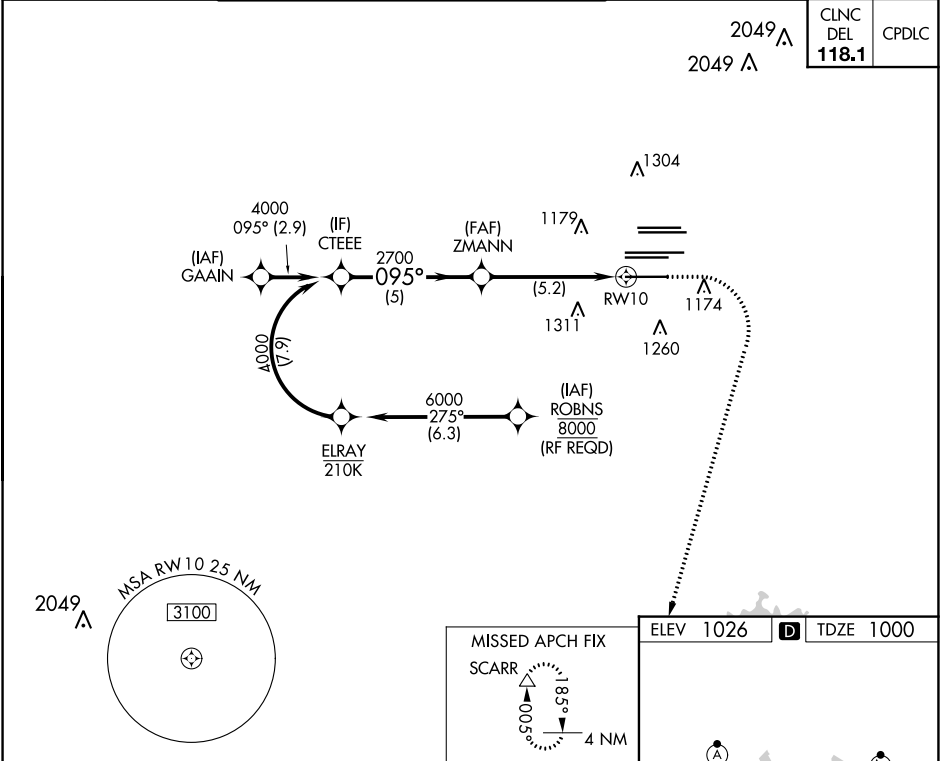

CTEEE

ZMANN

RW10

GP 3.00° TCH 55

4000

2700

2700

5 NM

5.2 NM

MISSED APCH FIX

SCARR

1500

3000

SCARR

180°

4 NM

CATEGORY	A	B	C	D
RNP 0.11 DA		1290/24	290 (300-½)	
RNP 0.30 DA		1456/50	456 (500-1)	

AUTHORIZATION REQUIRED

ELEV 1026

TDZE 1000

HIRL all Rwy's

TDZ/CL Rwy's 8L, 9R, 10, 26R, 27L and 28